

# PURE EDGE LIGHTING

## TEST REPORT

### SCOPE OF WORK

LED Performance Testing

### MODEL NUMBER

LC.3-3W-3-D-30KZ-SA

### PROJECT NUMBER

G104797632

### REPORT NUMBER

104797632CHI-012

### ISSUE DATE

5/12/2022

### REVISED DATE

None

### TEST DATES

2022-05-09 through 2022-05-12.

### DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-3407

© 2017 INTERTEK



**REPORT NUMBER**

104797632CHI-012

**MODEL NUMBER(s)**

LC.3-3W-3-D-30KZ-SA

**REPORT RENDERED TO:**

PURE EDGE LIGHTING  
1718 WEST FULLERTON AVE  
CHICAGO, IL 60614  
USA

**STATEMENT OF LIMITATION**

NVLAP Lab Code 600186-0. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

**AUTHORIZATION**

The testing performed was authorized by signed quote number Qu-01199885-2.

**TEST STANDARDS**

IESNA LM-79 - 2008: Electrical and Photometric Measurements of Solid State Lighting

ANSI/IES LM-79-19 Optical and Electrical Measurements of Solid-State Lighting Products

ANSI NEMA ANSLG C78.377: 2017: Specifications for the Chromaticity of Solid State Lighting (SSL) Products

IES TM-30-18: IES Method for Evaluating Light Source Color Rendition

In Charge of Testing:



Maximilian Carvajal  
Engineer  
Lighting Division

Reviewer:



Jeff Davis  
N.A. Technical Lead  
Lighting Division

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

**SAMPLE INFORMATION**

**REPORT NO. 104797632CHI-012**

**ITEMS RECEIVED**

Item No.	Control No.	Model No.	Description	Type	Received
1	AH04282022112833	LC.3-3W-3-D-30KZ-SA	LINEAR STRIP LIGHT	Production	4/28/2022

**TESTED SAMPLE CONFIGURATIONS**

Config No.	Tested Model No.	Item Nos. Utilized
1	LC.3-3W-3-D-30KZ-SA	1

**SAMPLE PHOTOS - TESTED CONFIGURATIONS**



## SUMMARY

REPORT NO. 104797632CHI-012

### PRODUCT INFORMATION AND SUMMARY OF DATA

Product Model No.:	LC.3-3W-3-D-30KZ-SA
Product Description:	LINEAR STRIP LIGHT
LED Model No.:	EASING HOME 4MM COB
Driver Model No.:	DR-24V-1100-33D
Light Source:	LED

Criteria	Results	
	Goniophotometer	Integrating Sphere
Light Output (lumens)	789.2	771.6
Input Power (W) @ 120V (Vac)	21.05	20.94
Lumen Efficacy (lm/W)	37.5	36.9
Input Power Factor ( ) @ 120V (Vac)	0.986	0.986

Criteria	Results
Input ATHD (%) @ 120V (Vac)	14.52
Correlated Color Temperature (K)	2757
Color Rendering Index - Ra ( )	96.4
Color Rendering Index - R9 ( )	82.1
Duv ( )	0.0001
Chromaticity Coordinate (x)	0.455
Chromaticity Coordinate (y)	0.410
Chromaticity Coordinate (u')	0.260
Chromaticity Coordinate (v')	0.526

## TEST METHODS

### SEASONING IN SAMPLE ORIENTATION - LED PRODUCTS

No seasoning was performed in accordance with IESNA LM-79.

### INTEGRATING SPHERE TESTING

A spectroradiometer and integrating sphere were used to measure the spectral distribution for each EUT resulting in photometric and colorimetric data. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position inside the sphere and stabilization procedures to LM-79 were followed.

### TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

A Type C Mirror Goniophotometer system was used to measure the luminous intensity (candela) at each angle of distribution for the EUT. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position near the EUT at equal height and stabilization procedures to LM-79 were followed.

**TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING**

**REPORT NO. 104797632CHI-012**

Test Configuration	Tested Model No.	Pass/Fail/NA
1	LC.3-3W-3-D-30KZ-SA	NA

**PHOTOMETRIC AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)**


Base Orientation	Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor (I)
Up	119.96	178.1	21.05	0.986

Light Output (lm)	Lumen Efficacy (lm/W)
789.2	37.5

**INTENSITY SUMMARY - CANDELA**

Angle	0	22.5	45	67.5	90
0	317.0	317.0	317.0	317.0	317.0
5	313.5	311.4	313.2	316.4	324.2
10	308.2	305.5	307.1	309.8	317.2
15	299.5	295.6	296.7	298.8	305.8
20	287.0	282.4	282.9	283.9	290.6
25	271.3	265.8	266.1	266.4	272.5
30	252.5	246.6	246.7	246.4	251.6
35	231.8	225.4	225.5	224.5	229.2
40	209.7	203.1	202.7	201.5	205.5
45	186.6	180.5	179.8	178.0	180.6
50	163.4	157.7	156.2	154.1	156.2
55	139.3	134.8	132.5	130.8	132.4
60	116.5	112.1	109.6	108.4	109.5
65	93.1	89.9	88.0	86.9	87.7
70	71.6	69.0	67.8	67.2	67.7
75	52.0	49.3	48.8	48.8	49.0
80	33.2	31.2	31.2	31.4	31.8
85	16.6	14.7	15.4	16.0	16.3
90	0.0	0.0	0.0	0.0	0.0
95	0.0	0.0	0.0	0.0	0.0
100	0.0	0.0	0.0	0.0	0.0
105	0.0	0.0	0.0	0.0	0.0
110	0.0	0.0	0.0	0.0	0.0
115	0.0	0.0	0.0	0.0	0.0
120	0.0	0.0	0.0	0.0	0.0
125	0.0	0.0	0.0	0.0	0.0
130	0.0	0.0	0.0	0.0	0.0
135	0.0	0.0	0.0	0.0	0.0
140	0.0	0.0	0.0	0.0	0.0
145	0.0	0.0	0.0	0.0	0.0
150	0.0	0.0	0.0	0.0	0.0
155	0.0	0.0	0.0	0.0	0.0
160	0.0	0.0	0.0	0.0	0.0
165	0.0	0.0	0.0	0.0	0.0
170	0.0	0.0	0.0	0.0	0.0
175	0.0	0.0	0.0	0.0	0.0
180	0.0	0.0	0.0	0.0	0.0



Entire luminous intensity matrix found in .IES file

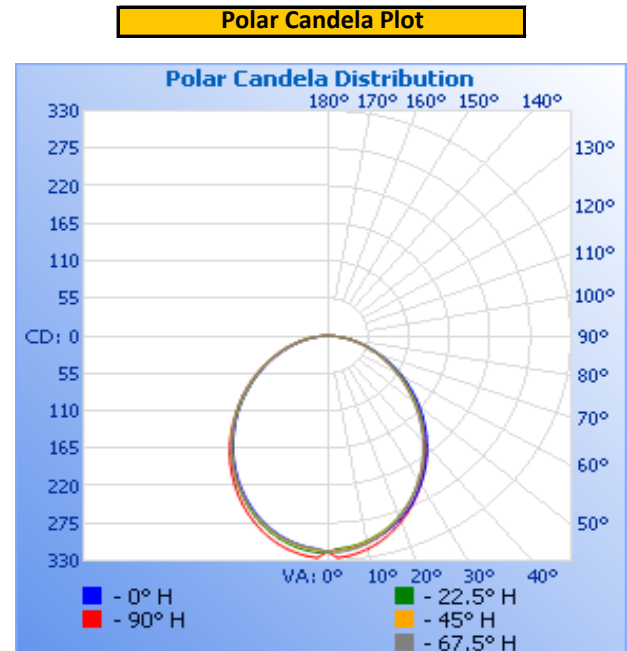

**REPORT NO. 104797632CHI-012**

ILLUMINANCE SUMMARY

Mounting Height: 10ft	
Illuminance - Cone Of Light	Isoillumination Plot

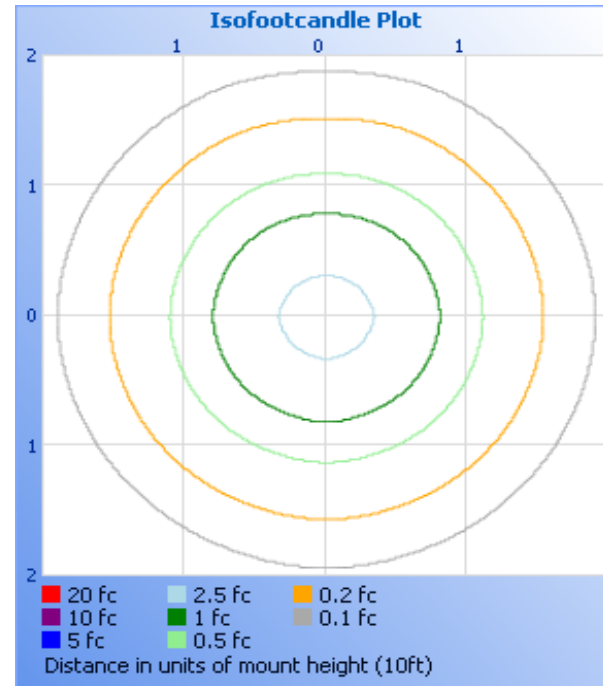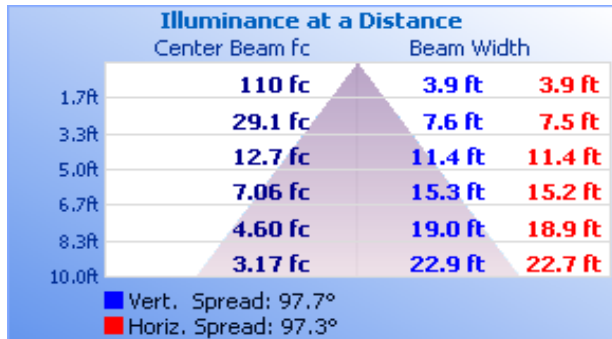

ZONAL LUMENS

**Zonal Lumen Summary**

Zone	Lumens	Luminaire
0-30	236.2	29.9%
0-40	377.1	47.8%
0-60	633.9	80.3%
60-90	155.3	19.7%
70-100	68.1	8.6%
90-120	0.0	0.0%
0-90	789.2	100.0%
90-180	0.0	0.0%
0-180	789.2	100.0%

Zone	Lumens	Total	Zone	Lumens	Total
0-10	29.8	3.8%	90-100	0.0	0.0%
10-20	83.8	10.6%	100-110	0.0	0.0%
20-30	122.6	15.5%	110-120	0.0	0.0%
30-40	140.9	17.8%	120-130	0.0	0.0%
40-50	138.3	17.5%	130-140	0.0	0.0%
50-60	118.5	15.0%	140-150	0.0	0.0%
60-70	87.2	11.0%	150-160	0.0	0.0%
70-80	51.5	6.5%	160-170	0.0	0.0%
80-90	16.7	2.1%	170-180	0.0	0.0%

**INTEGRATING SPHERE TESTING**

**REPORT NO. 104797632CHI-012**

Test Configuration	Tested Model No.	Pass/Fail/NA
1	LC.3-3W-3-D-30KZ-SA	NA

**PHOTOMETRIC, COLORIMETRIC, AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)**


Base Orientation
Up

Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor (l)	Input ATHD (%)
119.98	177.1	20.94	0.986	14.52

**Measured at 119.98(Vac)**

Light Output (lm)	Lumen Efficacy (lm/W)	CCT (K)	CRI - Ra (l)	CRI - R9 (l)
771.6	36.9	2757	96.4	82.1

Duv (l)	1931 Chrom (x)	1931 Chrom (y)	1976 Chrom (u')	1976 Chrom (v')
0.0001	0.455	0.410	0.260	0.526

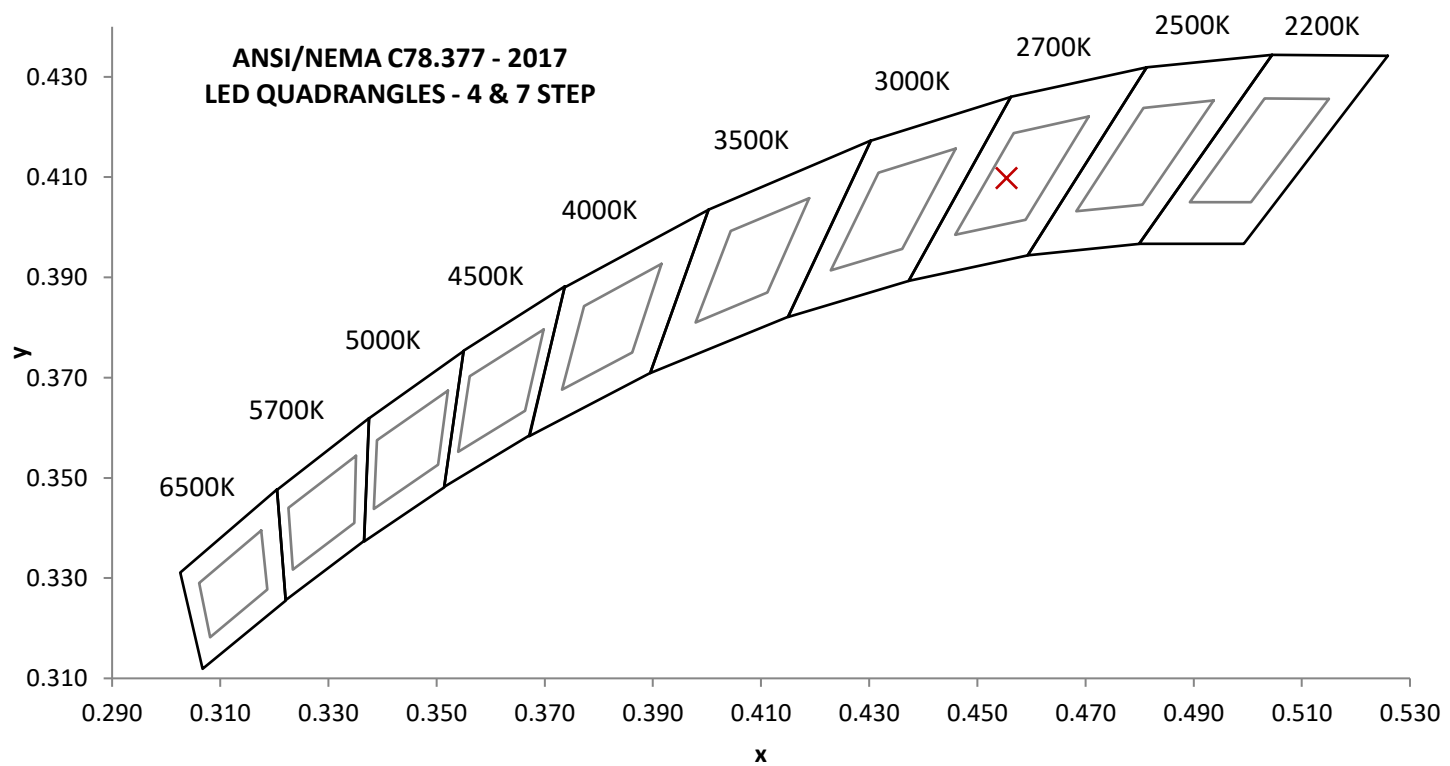


REPORT NO. 104797632CHI-012

SPECTRAL DISTRIBUTION OVER WAVELENGTHS

nm	mW/nm		nm	mW/nm		nm	mW/nm		nm	mW/nm
350	0.0		460	4.1		570	10.3		680	10.3
355	0.0		465	3.7		575	10.7		685	9.4
360	0.1		470	3.2		580	11.2		690	8.5
365	0.0		475	2.6		585	11.7		695	7.6
370	0.1		480	2.7		590	12.1		700	6.8
375	0.0		485	3.0		595	12.7		705	6.0
380	0.0		490	3.5		600	13.2		710	5.3
385	0.1		495	4.1		605	13.8		715	4.6
390	0.1		500	4.9		610	14.3		720	4.0
395	0.1		505	5.6		615	14.9		725	3.5
400	0.1		510	6.2		620	15.4		730	3.0
405	0.1		515	6.8		625	15.9		735	2.6
410	0.1		520	7.2		630	16.2		740	2.3
415	0.2		525	7.6		635	16.3		745	2.0
420	0.3		530	8.0		640	16.2		750	1.7
425	0.5		535	8.3		645	15.9		755	1.5
430	0.8		540	8.6		650	15.5		760	1.3
435	1.3		545	8.9		655	14.8		765	1.1
440	2.3		550	9.1		660	14.0		770	0.9
445	4.2		555	9.4		665	13.1		775	0.8
450	6.3		560	9.7		670	12.2		780	0.7
455	5.7		565	10.0		675	11.2		---	---

Without correction of sample absorption.

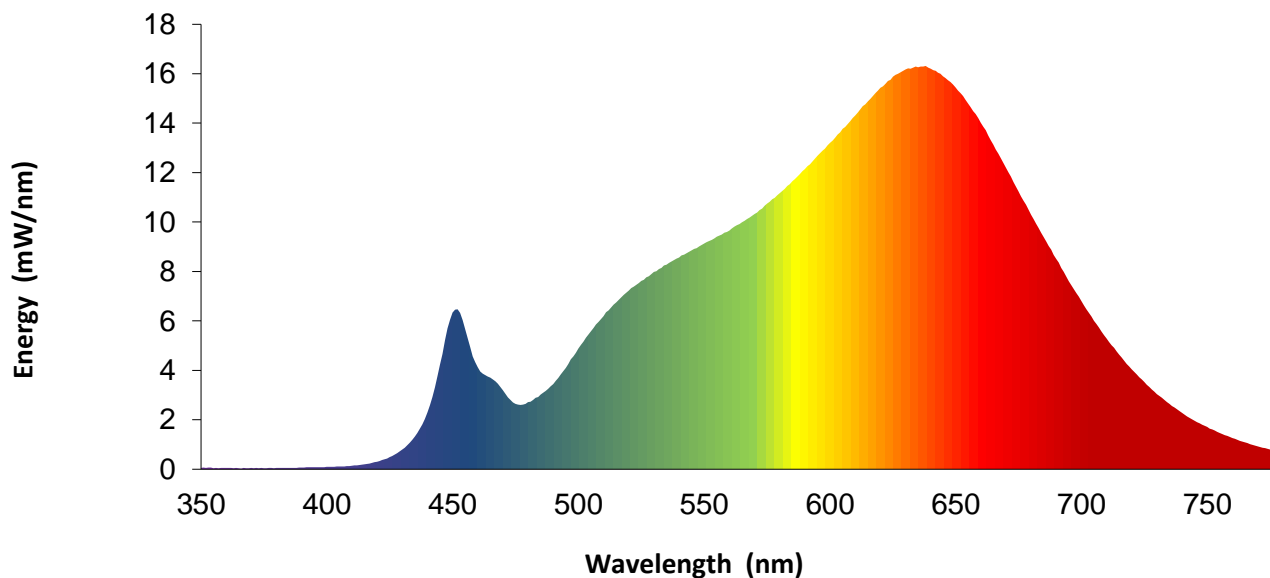

Portrayed color in graphic is estimated by wavelength (nm) and may not be exact - it is a visual representation only



## EQUIPMENT LIST

REPORT NO. 104797632CHI-012

#	Equipment	Model No	Control No.	Last Cal	Cal Due
1	Yokogawa Power Meter	WT310E	CHI0664	3/30/2022	3/30/2023
2	Omega Thermometer	DPI8-C24	146920	10/4/2021	10/4/2022
3	LSI High Speed Mirror Goniometer	6440T	146928	VBU	VBU
4	Newport Thermohygrometer	iServer	CHI0452	2/3/2022	2/3/2023
5	Chroma Power Supply	61604	CHI0371	VBU	VBU
8	Newport Humidity Recorder	iServer	146961	9/21/2021	9/21/2022
9	Labsphere Spectroradiometer	CDS2600	CHI0539	VBU	VBU
10	3 Meter Sphere	SPR600	CHI0088	VBU	VBU
11	Elgar AC Power Supply	CW1251	146112	VBU	VBU
12	Sorenson DC Power Supply	XFR150-8	146846	VBU	VBU
13	Yokogawa Power Meter	WT1600	146767	4/4/2022	4/4/2023
17	Omega thermometer	USB TC08	EQA002615	4/5/2022	4/5/2023
26	Xitron Power Analyzer	XT-2640	CHI0611	6/9/2021	6/9/2022

Note: Standard sources listed above are traceable to NIST: National Institute of Standards and Technology

## REVISION HISTORY

#	Revision Date	Updated By	Reviewed By	Description of Change
---	None	---	---	---
---	---	---	---	---
---	---	---	---	---

Test Configuration	Tested Model No.	Pass/Fail/NA
1	LC.3-3W-3-D-30KZ-SA	NA







## ANSI/IES TM-30-18 Color Rendition Report

Source: User SPD

Manufacturer: Pure Edge Lighting

Date: 5/12/2022

Model: LC.3-3W-3-D-30KZ-SA

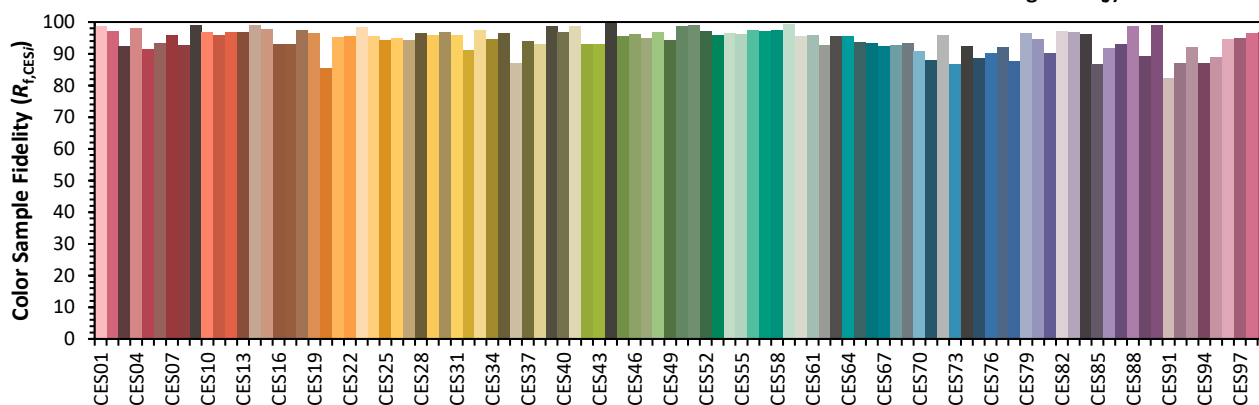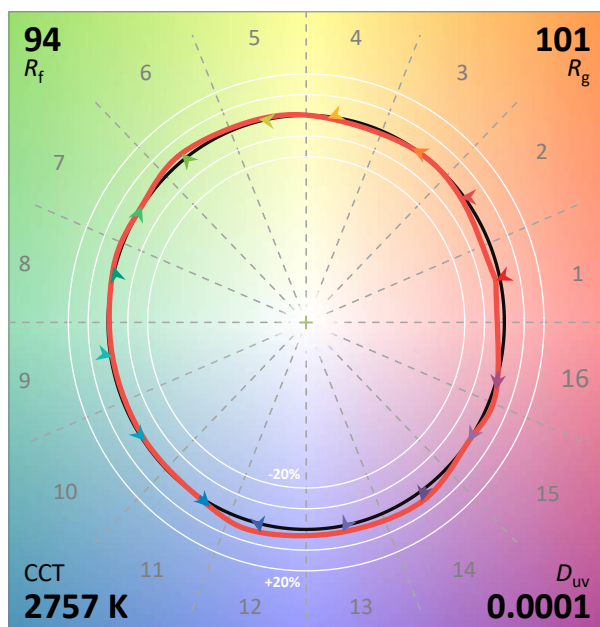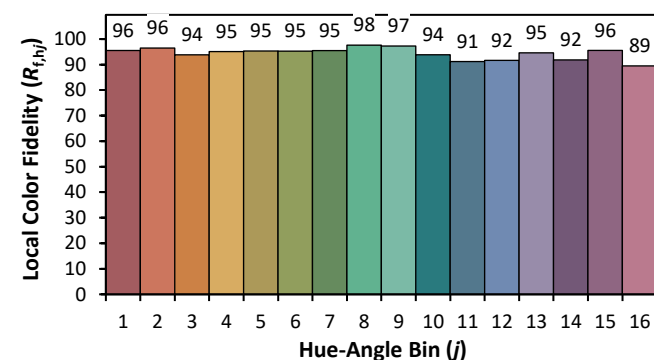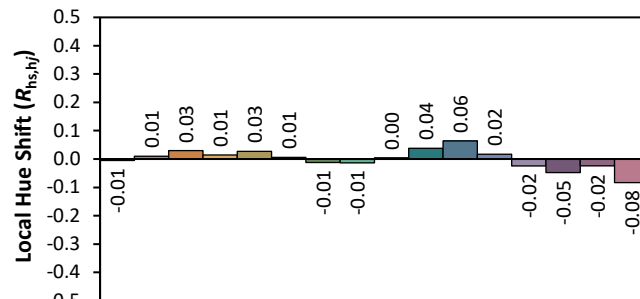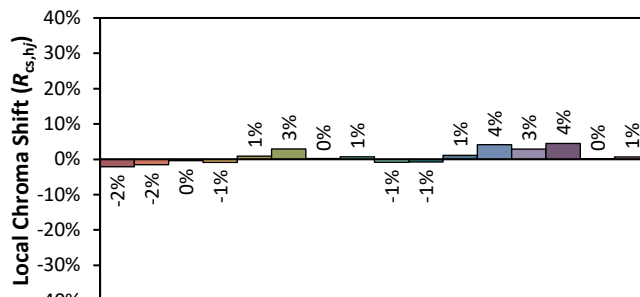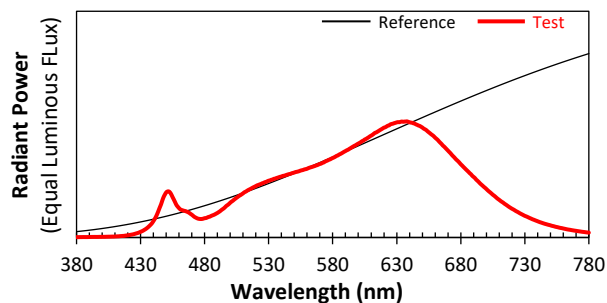

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.4554

y 0.4098

u' 0.2600

v' 0.5264